


WATER SUPPLY **W138A**

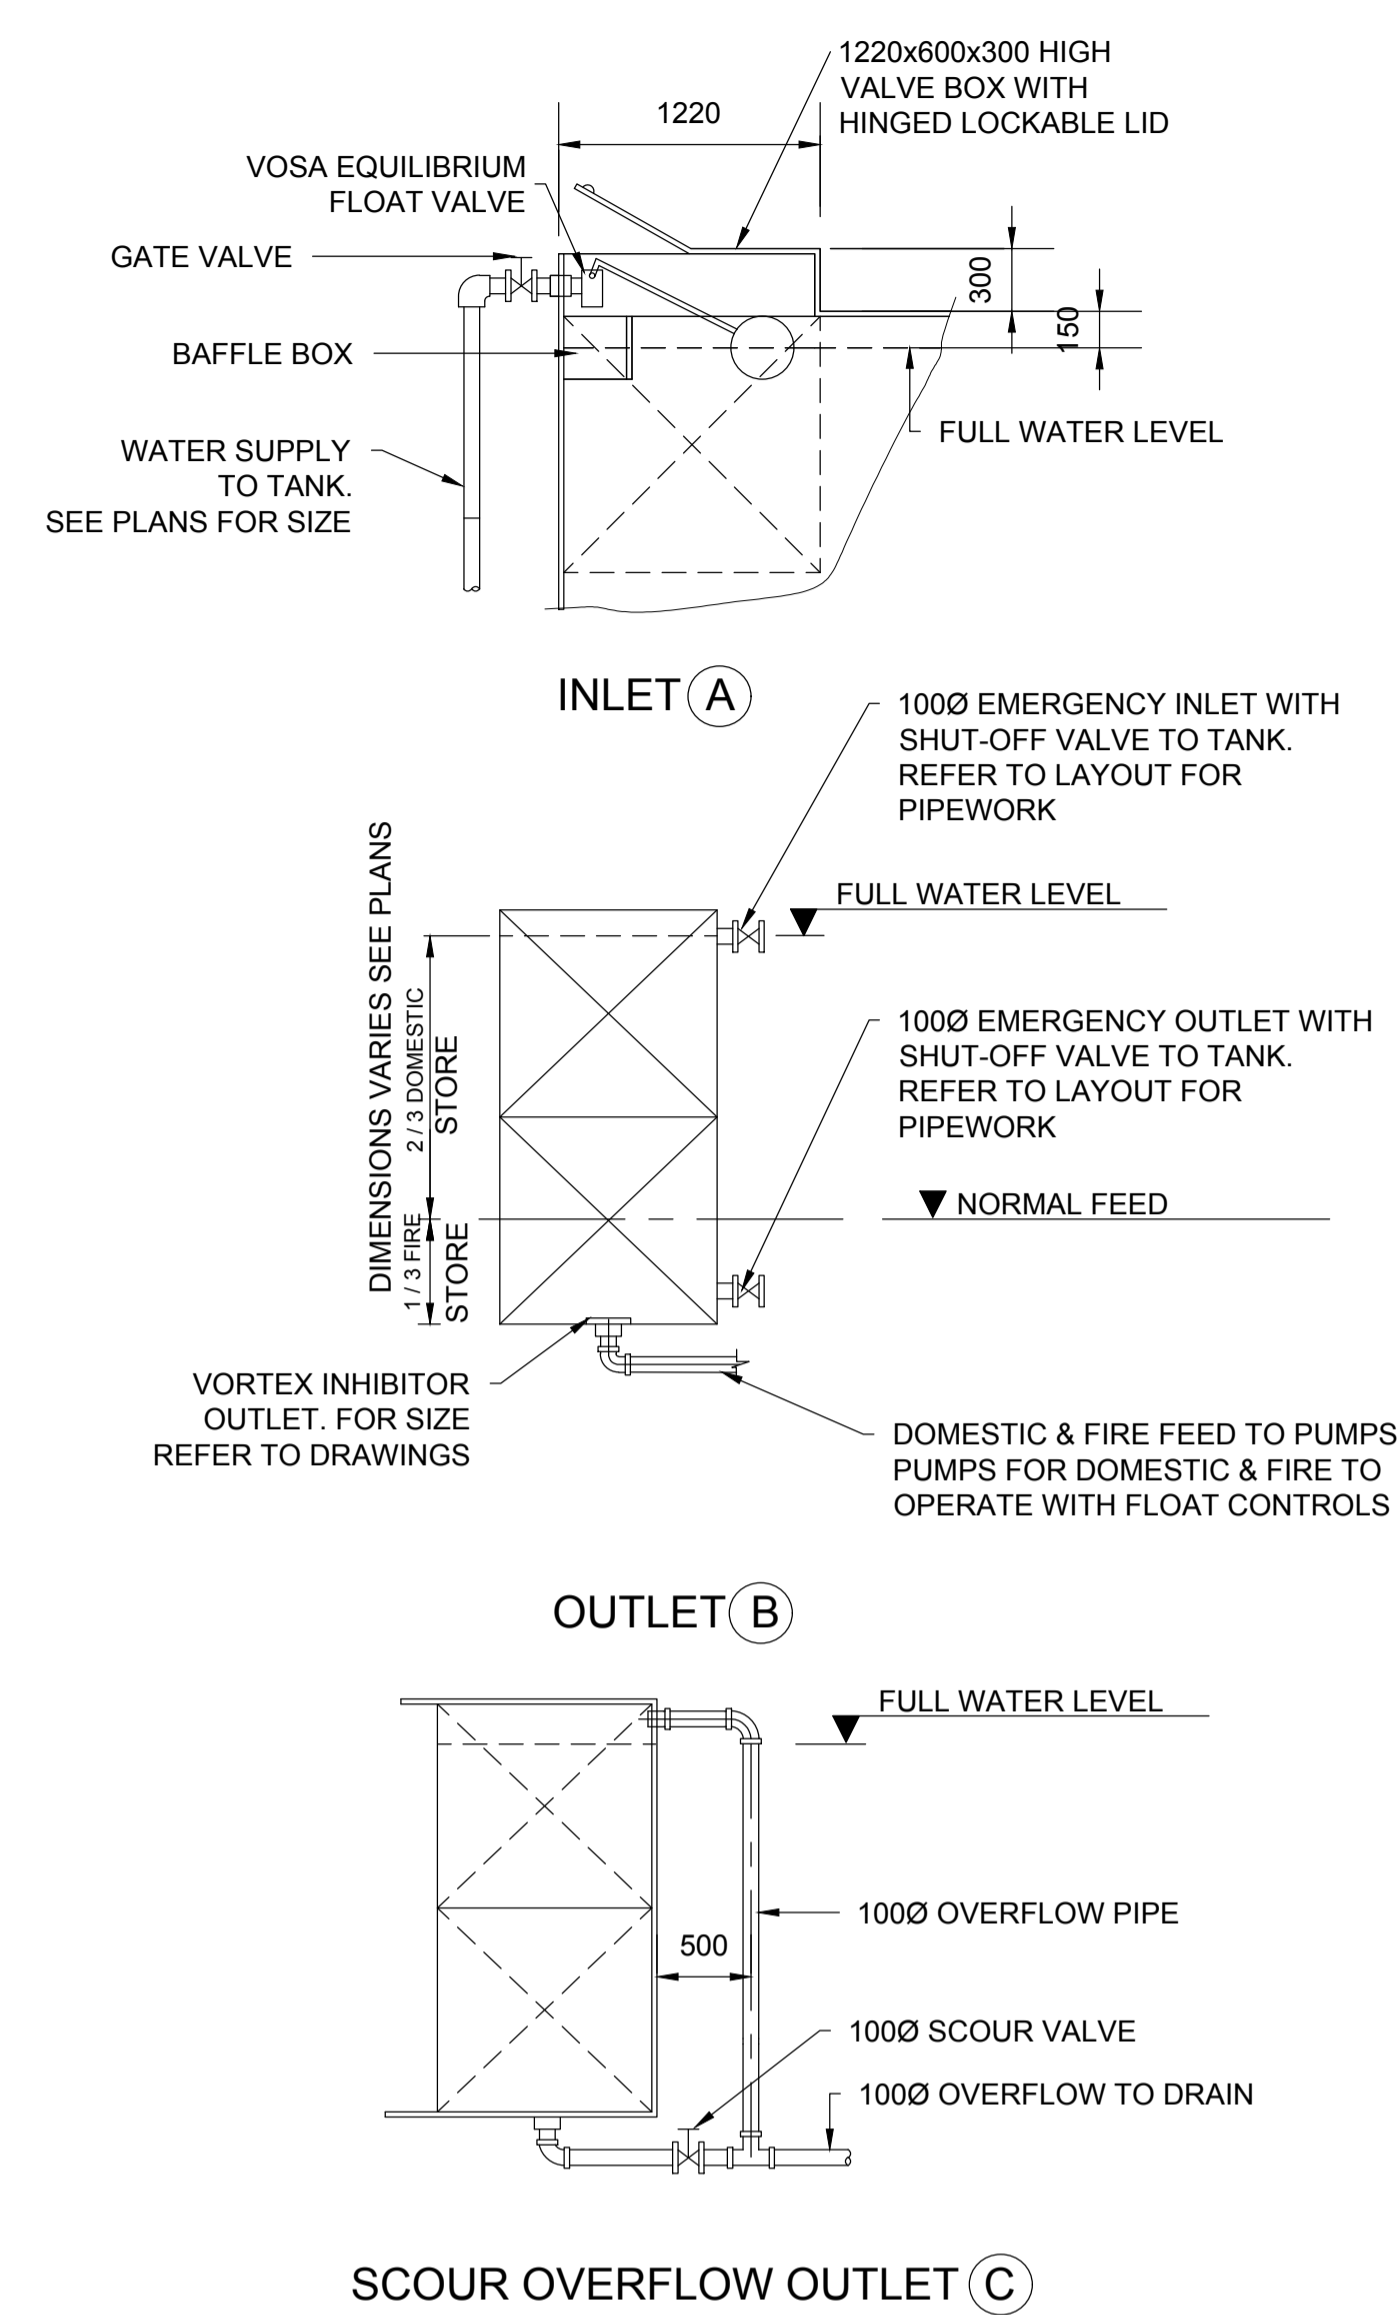

- NOTES:**
1. DETAILS ARE TYPICAL
 2. TANKS TO BE SECTIONAL STEEL TYPE VIEW OR SIMILAR APPROVED
 3. SEE SEPERATE DETAILS FOR TANK SUPPORTS
 4. CHLORINATION OF TANKS : ADD HTH CHLORINE TO TANK AT A RATE OF 0,15 GRAMS PER LITRE OF WATER AND LEAVE FOR 24 HOURS BEFORE FLUSHING THE SYSTEM
 5. ALL TANKS TO BE LINES INTERNALLY WITH ABE SUPER LAYKOLD RUBBERISED BITUMEN WATERPROOFING EMULSION TO MANUFACTURERS SPECIFICATION. SEE DETAIL W119
 6. LEVEL INDICATOR TO BE PROVIDED
 7. LADDER WITH SAFTY CAGE AND LOCKABLE ACCESS GATE TO BE PROVIDED

- NOTES**
1. FOR GENERAL NOTES, REFER TO DRAWING: N/A
 2. DRAWINGS ARE NOT TO BE SCALED. ALL LEVELS AND DIMENSIONS TO BE VERIFIED ON SITE PRIOR TO COMMENCEMENT OF WORKS. ANY DISCREPANCIES TO BE BROUGHT TO THE ENGINEER / ARCHITECTS ATTENTION IMMEDIATELY
 3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS, SCHEDULES AND SPECIFICATIONS RELATED TO THIS PROJECT.
 4. ALL BUILDING WORK AND MATERIALS ARE TO COMPLY WITH LOCAL AUTHORITY'S REQUIREMENTS AND ARE TO BE IN ACCORDANCE WITH SANS 10400 NATIONAL BUILDING REGULATIONS
 5. ALL OPENINGS TO BE MEASURED ON SITE BEFORE MANUFACTURING OF DOORS, WINDOWS, GATES, LOUVRES, ROLLERSHUTTER DOORS, SHOPFRONTS ETC.
 6. SPECIALIST TO CHECK & CONFIRM ALL WINDOWS & SHOPFRONT BEFORE MANUFACTURER
 7. ALL FINISHES AS PER SPECIFICATION DOCUMENT

IR	DATE	DESCRIPTION	ISS BY

DRAWING CHECKS

DESIGNED BY	W. J. OBERHOLZER	N/A
DRAWN BY	E. HUYSAMEN	N/A
DESIGNED CHECKED BY	S. ALLY	N/A
DRAWING CHECKED BY	W. J. OBERHOLZER	N/A

APPROVAL CONSULTANT

NAME	W. J. OBERHOLZER	DATE	2019-01-28
PROF REG. No.	201270058	SIGNATURE	

THE MASTER HELD AT THE AECOM CENTURION OFFICE BEARS THE ORIGINAL SIGNATURE OF APPROVAL

BUILDING/FACILITY/ZONE

OVERALL BUILDING SITE

PROJECT NUMBER

60586065

SHEET TITLE

WATER DETAILS
SHEET 2 OF 2

DISCIPLINE

WET SERVICES

DRAWING NUMBER

PROJECT | ORG. | BS CODE | LEVEL | TYPE | ROLE | SERIAL NO. | STAT | REV
 60586065-ACM- 00 - 00 - DR - PH - 080003 - T - 0
 0 DRAFT / PRELIMINARY / TENDER / FINAL / C CONSTRUCTION / AS-BUILT / RECORD / REREPORT
 SCALE **1:100**

FOR TENDER ONLY

ISO A1 150mm x 841mm

Last Modified: 2019/01/28 11:35:37 AM
 Path: Z:\PROJECTS\60586065-ACM-00-00-DR-PH-080003-T-0.DWG
 Author: S. ALLY
 Title: WATER SUPPLY DETAILS - BULK WATER

COPYRIGHT RESERVED